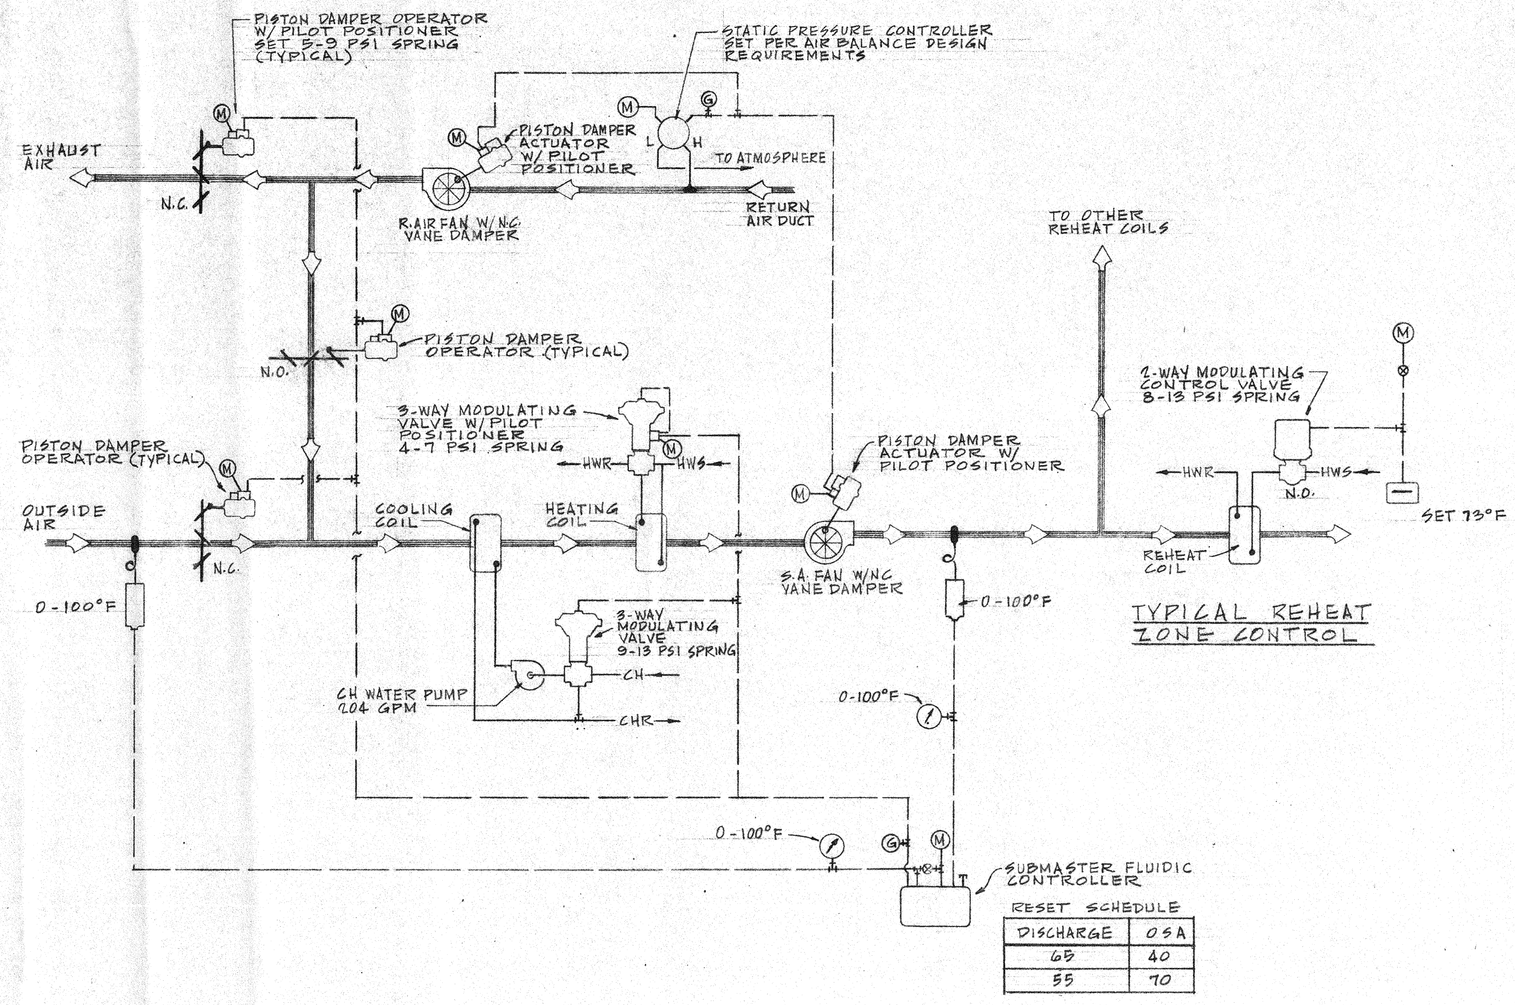

TYPICAL REHEAT ZONE CONTROL

NORTH BLDG — AIR SYSTEM CONTROL DIAGRAM
(ONE (1) REQUIRED)

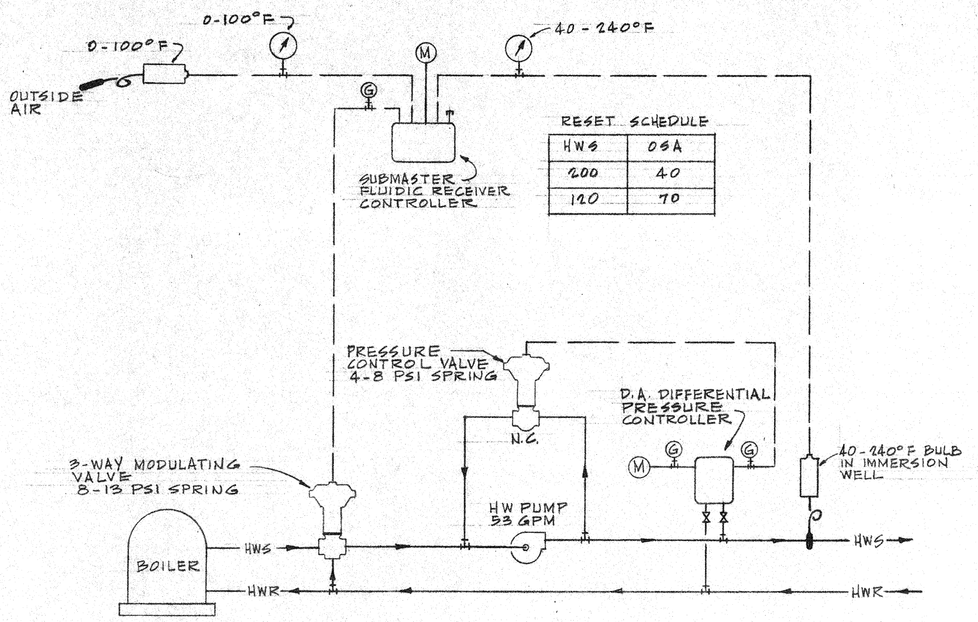

NORTH BLDG — HEATING WATER CONTROL DIAGRAM
(ONE (1) REQUIRED)

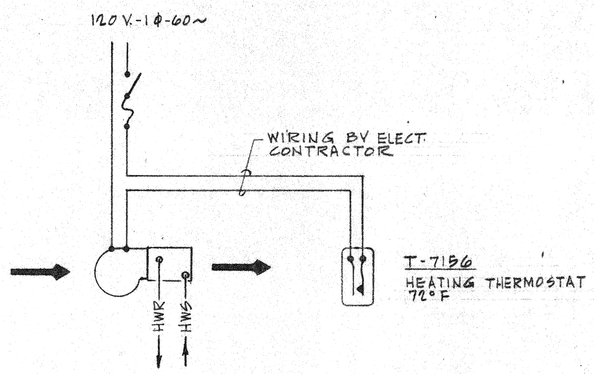

UNIT HEATER CONTROL DIAGRAM

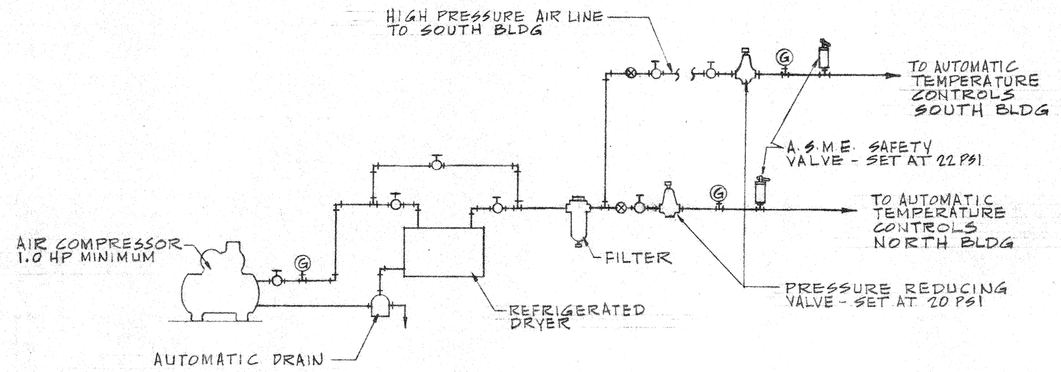

CENTRAL TEMPERATURE CONTROL AIR COMPRESSOR DIAGRAM
(ONE (1) REQUIRED)

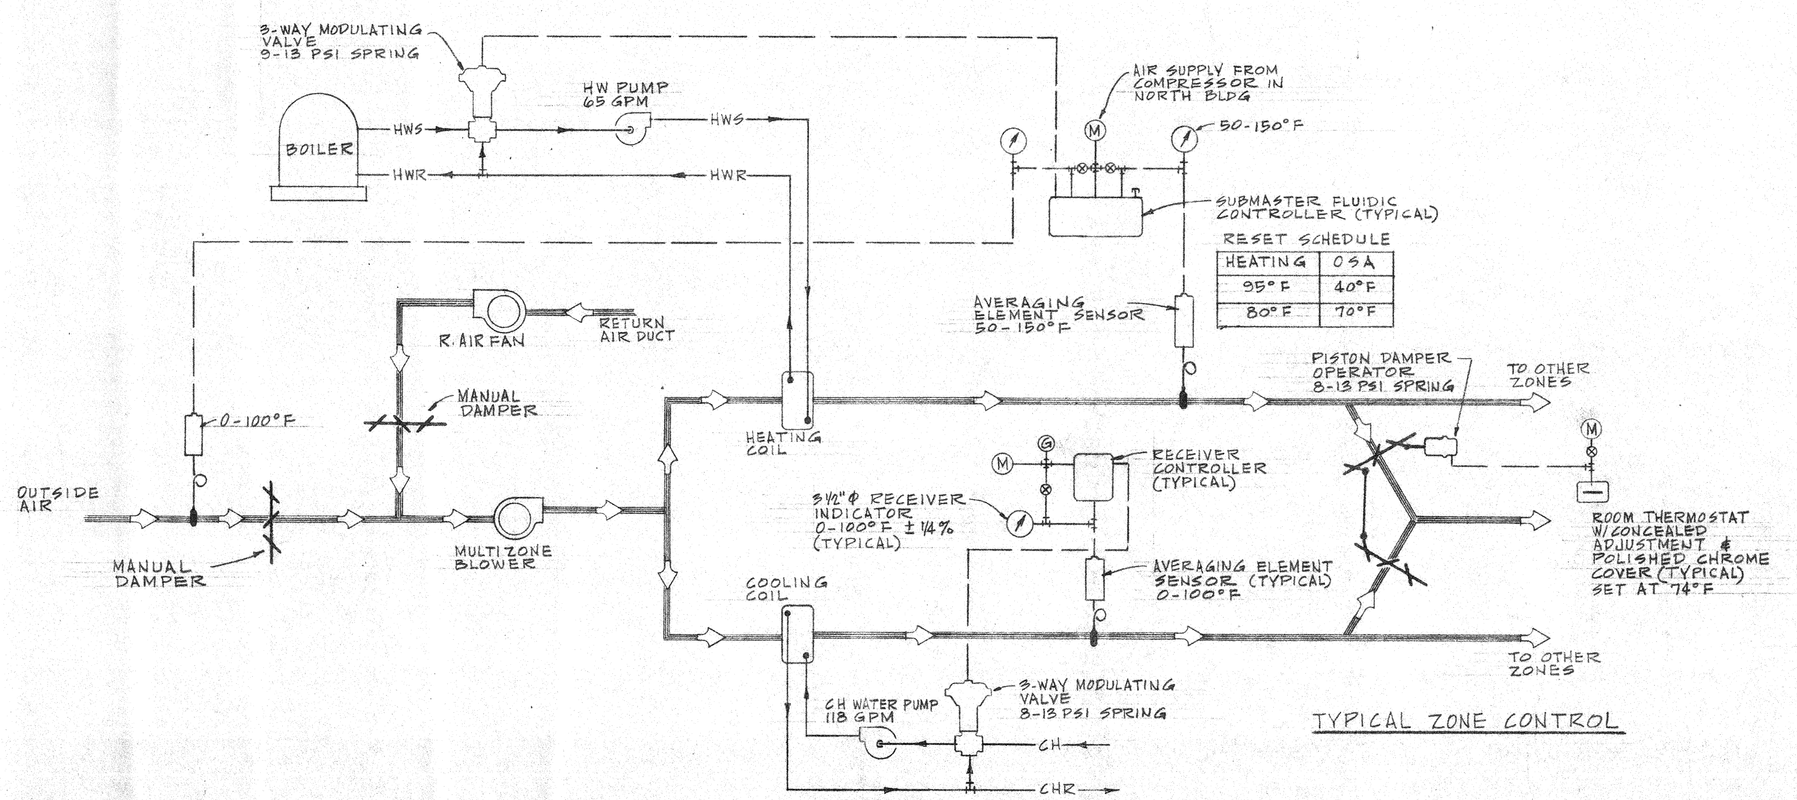

TYPICAL ZONE CONTROL

SOUTH BLDG — MULTIZONE AIR HANDLING UNIT CONTROL DIAGRAM
(ONE (1) REQUIRED)

CONTROL DIAGRAMS LEGEND

SYMBOL	DESCRIPTION
	DUCT & DIRECTION OF AIR FLOW
—HWS—	HOT WATER HEATING SUPPLY
—HWR—	HOT WATER HEATING RETURN
—CH—	CHILLED WATER SUPPLY
—CHR—	CHILLED WATER RETURN
— — —	COMPRESSED AIR
M	COMPRESSED AIR MAIN
S	COMPRESSED AIR BRANCH
G	PRESSURE GAUGE
⊗	BALANCING COCK
T	THERMOMETER
—⊙—	SHUT OFF VALVE
N.C.	NORMAL CLOSED
N.O.	NORMAL OPEN
C	COMMON
D.A.	DIRECT ACTING
R.A.	REVERSE ACTING

Blaylock Engineers
Mechanical and Electrical Engineering
1909 McKee Street, San Diego, Calif. 92110

ROBERT MASON HOUVENER ARCHITECT
7160 HERSCHEL AVENUE LA JOLLA, CALIFORNIA 92037 TELE. 714/459-4888

CIVIC CENTER
CITY OF THOUSAND OAKS, CALIFORNIA

AUTOMATIC TEMPERATURE CONTROL DIAGRAMS

REVISIONS:

MP 16
SHT. 74